


Flanged seals with flush diaphragm S-P

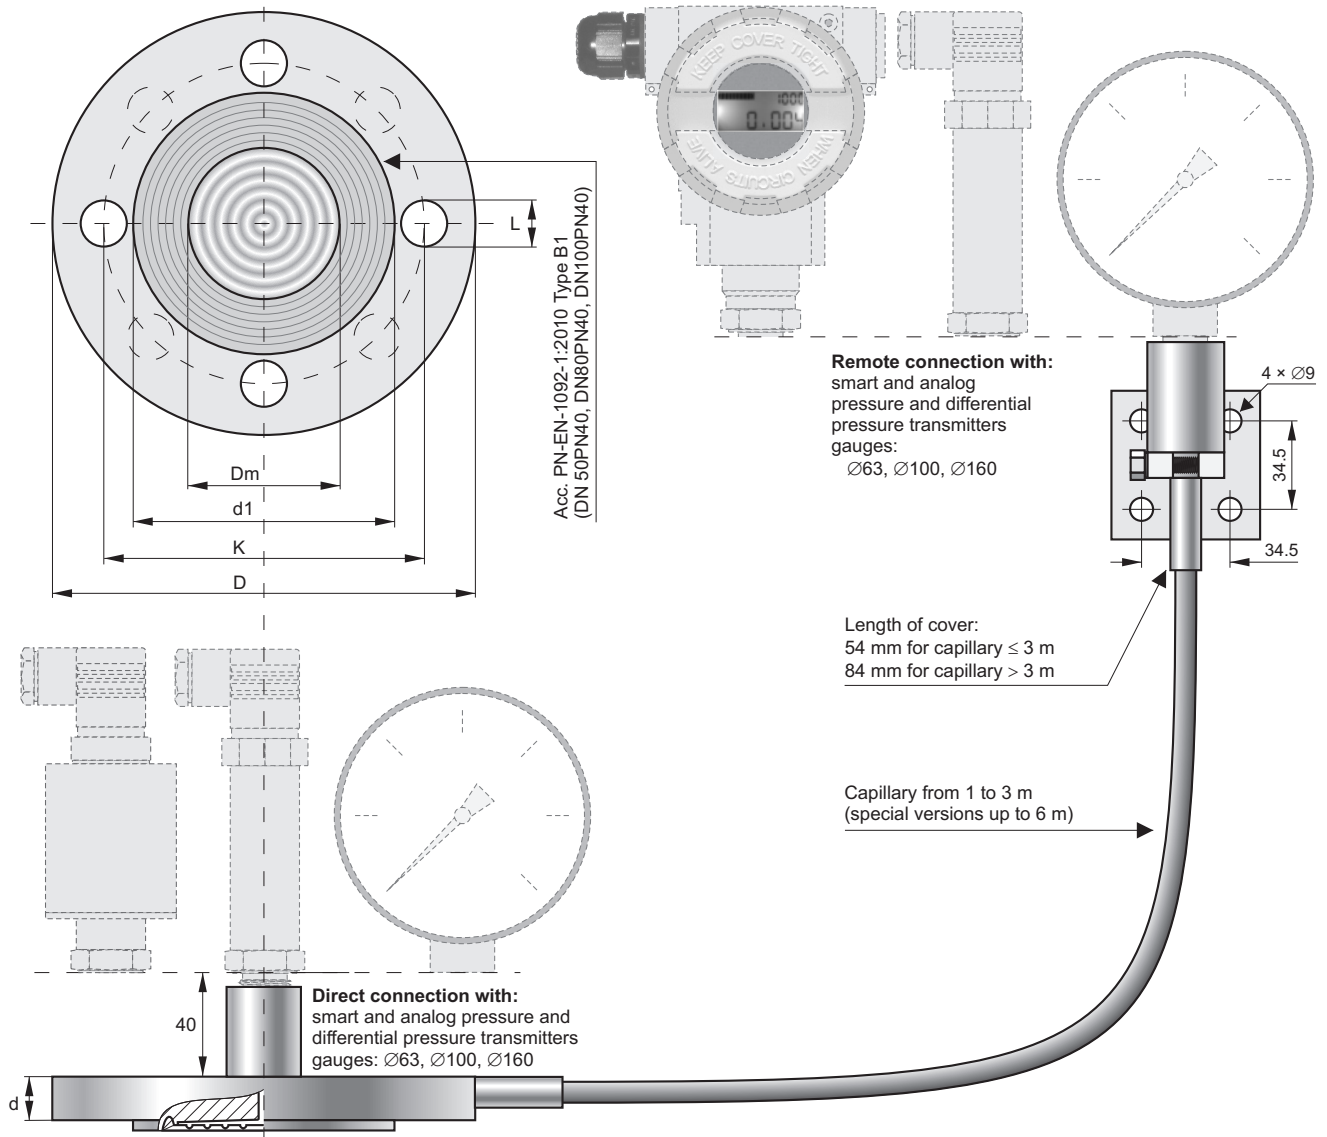

Diaphragm seal dimensions

Version	Diaphragm diameter Dm	Contact face diameter d1	Diameter of bolt circle K	External diameter D	Thickness d	Diameter of holes L	Number of holes
DN50 PN40/ 2" ANSI 150	59	102	125	165	22	18	4
	59	92	120,5	150	20	20	4
DN80 PN40	89	138	160	200	24	18	8
3" ANSI 150	89	127	152,5	190	24	20	4
DN100 PN40	89	162	190	235	24	22	8
4" ANSI 150	89	158	190,5	230	24	20	8

Application

The diaphragm seal is a pressure-transmitting, diaphragm-type device. The pressure signal is sent to the cooperating pressure measuring device (pressure transmitter, pressure gauge) through manometric liquid filling the space between the separating diaphragm of the seal and the pressure measuring device. The diaphragm seal task is to isolate the pressure measuring device from damaging impacts caused by either medium or installation:

- low or high temperature, increased viscosity, impurities;
- vibrations of the installation (remote diaphragm seal).

**Recommended minimum measuring range (bar),
depending on the type of the set: pressure measuring device - diaphragm seal**

Pressure measuring device	Diaphragm seal type	Diaphragm seal version		
		DN50 / 2"	DN80 / 3"	DN100 / 4"
Smart transmitters*	direct	0.10	0.025	0.025
	remote (2 m)	1	0.25	0.25
PCE-28	direct	0.1	0.1	0.1
	remote (2 m)	1	0.25	0.25
Ø63 gauge	direct	1	1	1
	remote (2 m)	2.5	1	1
Ø100 gauge	direct	1	1	1
	remote (2 m)	2.5	1	1
Ø160 gauge	direct	6	1	1
	remote (2 m)	6	1	1

* The ranges given in the table for the smart transmitters should be taken as set ranges.

Recommendations

The essential metrological problem at diaphragm seals operational use is an absolute thermal zero error, resulting from the thermal expansion of the manometer liquid. The expansion effect must be compensated for with the separating diaphragm flexibility.

To minimise this effect, it is advisable to:

- use capillaries as short as possible, in this way the volume of manometer liquid will be reduced;
- use the greater diameter seals, in order to maximise the separating diaphragm flexibility;
- locate the capillaries in the places, in which the temperature fluctuations will be minimal.

Zero error from ambient temperature change

Diaphragm seal type	Absolute zero error per 10°C for the diaphragm seal		
	DN50 / 2"	DN80 / 3"	DN100 / 4"
direct	0.5 mbar	0.4 mbar	0.4 mbar
remote (2 m capillary)	3 mbar	1 mbar	1 mbar

An additional zero error, resulting from temperature fluctuations in a medium, depends on the temperature gradient in the oil-based diaphragm sealing system. The error value is, in any case, significantly smaller than the error value shown in the table.

Temperature range of measured medium

Remote diaphragm seal			Direct diaphragm seal
Manometric liquid	Underpressure measurements	Overpressure measurements	
very high temperature (DH)	max. 200°C for p > 0,05bar ABS	15...380°C	-30...150°C
high temperature (DC)	max. 250°C for p > 0,1bar ABS	-10...315°C	
low temperature (AK)	not recommended for measurement of pressures < 0,2 bar ABS	-60...200°C	

Note: When operating with an ambient temperature of < -15°C, heating of capillaries filled with DC fluid is recommended.

Special versions


Maximum pressure for PN40 – 40 bar
Maximum pressure for ANSI 150 – 150 psi
Material of diaphragm and flange: 316Lss

- Other standard ANSI or DIN
- Filled with edible oil (medium temp. -10...150°C)
- Direct diaphragm seal for medium temp. over 150°C
- Others

Important:

- standard outlet capillary from flange:
 - direct mounted diaphragm seal - axial
 - remote mounted diaphragm seal - radial
 - other configuration available on request

Ordering procedure

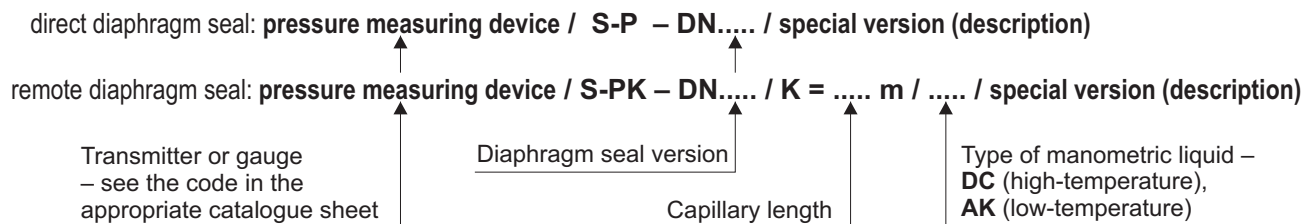

Example: PCE-28 pressure transmitter, Exia version, measuring range 0 ÷ 1 bar, cable connection, direct flanged seal with flush diaphragm

PCE-28 / Exia / 0 ÷ 1 bar / PK / S-P – DN50PN40